


PLAN

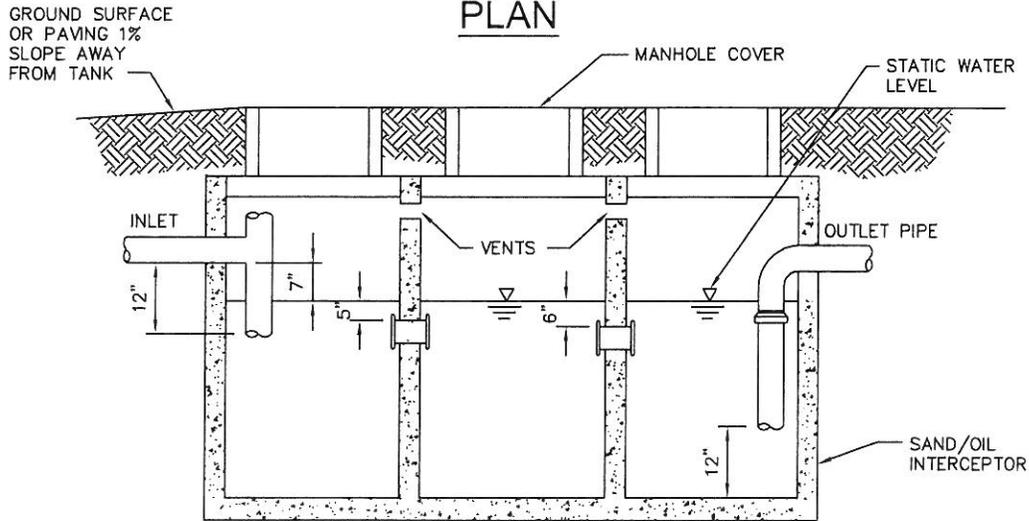

SECTION

NOTES

- ① SIZING PER UNIFORM PLUMBING CODE, CHAPTER 7, "TRAPS AND INTERCEPTORS".
- ② THE UNIT SHOWN SHALL BE MADE OF CONCRETE OR OTHER MATERIAL APPROVED BY THE CITY ENGINEER (SEE NOTE 3).
- ③ THE UNIT IS TO BE LOCATED AWAY FROM TRAFFIC, IF POSSIBLE. IF INSTALLED IN TRAFFIC, THE UNIT MUST BE CAPABLE OF CARRYING H-20 LOADINGS.
- ④ NO WASTE FROM RESTROOMS SHALL FLOW THROUGH INTERCEPTOR.
- ⑤ ALL WASTE SHALL ENTER THE INTERCEPTOR THROUGH THE INLET PIPE ONLY.
- ⑥ STRUCTURE SHALL BE INSTALLED TO ALLOW ACCESS FOR MAINTENANCE OR INSPECTION AT ALL TIMES.
- ⑦ ALL SURFACE WATER MUST DRAIN AWAY FROM THE SAMPLING BOX AND INTERCEPTOR TO EXCLUDE ANY SURFACE DRAINAGE.
- ⑧ INSPECTION COVERS SHALL BE BROUGHT TO GRADE TO PERMIT VISUAL INSPECTION OF INTERNAL FITTINGS, WITH RISERS AS REQUIRED.



APPROVED BY:		11-22-10	
<i>Louis Abi-Younes</i>		44485	
LOUIS ABI-YOUNES, CITY ENGINEER		RCE	DATE
RECOMMENDED:		10/25/10	
<i>Scott Burton</i>		57875	
SCOTT BURTON, UTILITIES ENG/OPERATIONS DIRECTOR		RCE	DATE
REV	DESCRIPTION	BY	APP'D DATE

CITY OF ONTARIO

THREE CHAMBER
SAND AND OIL
INTERCEPTOR

STANDARD
DRAWING
NUMBER

2202