


PROFILE VIEW

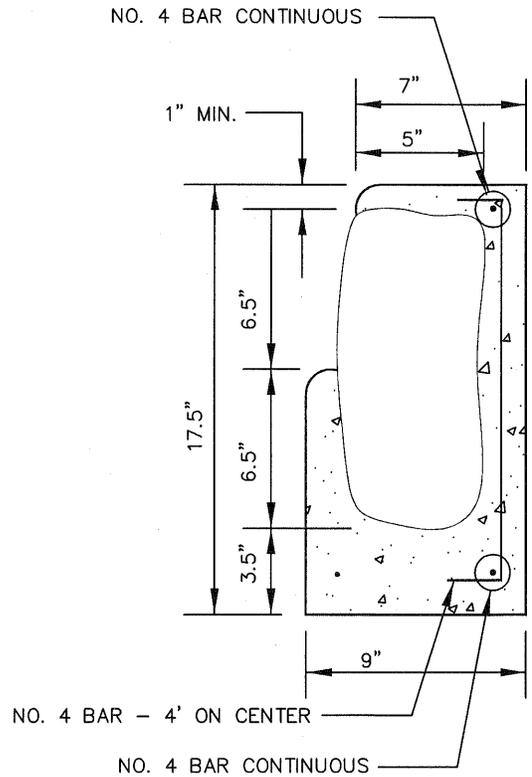

SECTION A-A

NOTES

1. CONCRETE SHALL BE CLASS 520-D-2500 PER SECTION 201 OF THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION, LATEST EDITION.
2. CURING COMPOUND SHALL BE TYPE 1-D PER SECTION 201 OF THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION, LATEST EDITION.
3. LONGITUDINAL RE-BAR SHALL HAVE SLIP JOINTS AT 60' ON CENTER AND CUT PLATES AT 20' ON CENTER.



APPROVED BY:				
<i>John P. Sullivan</i>				
JOHN P. SULLIVAN		24079	8/08/06	
CITY ENGINEER		RCE	DATE	
RECOMMENDED:				
<i>Jim Minnow</i>				
JIM MINNOW		33340	8/07/06	
ASSISTANT CITY ENGINEER		RCE	DATE	
REV	DESCRIPTION	BY	APP'D	DATE

CITY OF ONTARIO

ROCK CURB DETAIL

STANDARD
DRAWING
NUMBER

1202