


PLAN VIEW

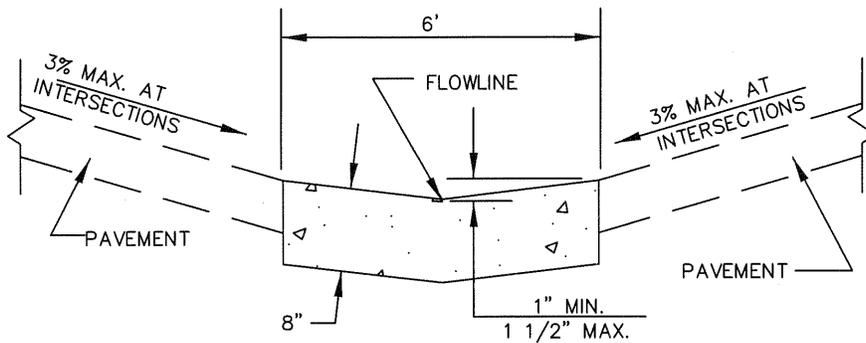

SECTION A-A

NOTES

1. SLOTTED CROSS GUTTER SHALL BE USED ONLY WHEN APPROVED BY THE CITY ENGINEER.
2. TYPE "B" GUTTER WIDTHS AT B.C.'S AND E.C.'S SHALL BE PER STANDARD DRAWING NO. 1201, OR MATCH EXISTING.
3. SEE STANDARD DRAWINGS NO. 1001-1005 FOR CURB AND PROPERTY LINE RADII.
4. CONCRETE SHALL BE CLASS 520-C-2500 PER SECTION 201 OF THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION, CURED WITH TYPE 1-D CURING COMPOUND.



APPROVED BY:		<i>John P. Sullivan</i>		24079 8/08/06	
JOHN P. SULLIVAN CITY ENGINEER		RCE		DATE	
RECOMMENDED:		<i>Sam M. Mack</i>		33340 8/07/06	
ASSISTANT CITY ENGINEER		RCE		DATE	
REV	DESCRIPTION	BY	APP'D	DATE	

CITY OF ONTARIO		STANDARD DRAWING NUMBER 1208
CROSS-GUTTER		