


1. ALL FIRE HYDRANTS SHALL HAVE GUARD POST
2. INSTALL BLUE RETRO-REFLECTIVE PAVEMENT MARKER ON ALL FIRE HYDRANTS (TWO AT INTERSECTIONS) IN ACCORDANCE WITH CITY OF ONTARIO FIRE DEPARTMENT STANDARDS/REQUIREMENTS.
3. ALL NEW FIRE HYDRANTS SHALL BE BAGGED (GUNNY SACK) UNTIL CONNECTING SYSTEM IS FULLY ACTIVATED.

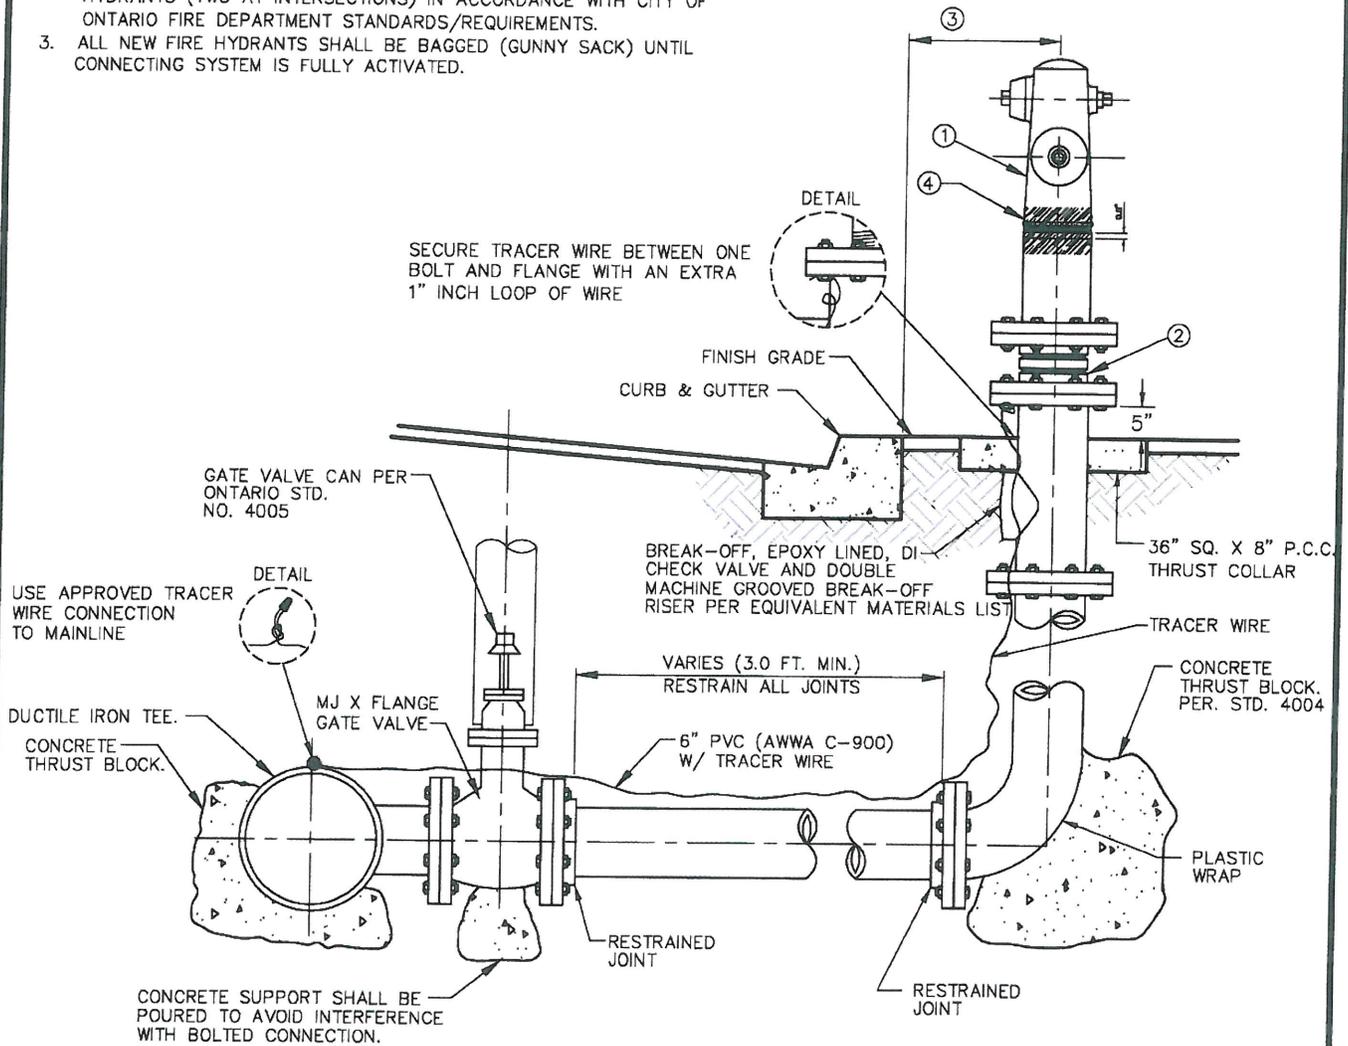

HYDRANTS TO BE PAINTED WITH PRIMER AND TWO (2) COATS OF YELLOW ACME PAINT. NO. 2-19057 OR APPROVED EQUAL.  
(NO PAINT ON BRASS OR BRONZE).

**NOTES**

- ① STANDARD FIRE HYDRANT, HEAD & FLUTED SPOOL COMPLETE. 1-4" STEAMER HOUSE OUTLET & 1-2 1/2" HOUSE OUTLET. 8 HOLE BOLT PATTERN.
- ② 6" DIA. C.I. BREAK-OFF SPOOL. 6" LONG, ONE END FLG'D. TO MATE W/6" A.S.A. 150# SLIP-ON FLG., OTHER END FLG'D TO MATE HYDRANT SPOOL. (SHOP FABRICATED)
- ③ 18" BEHIND CURB WHEN THE SIDEWALK IS ADJACENT TO THE RIGHT-OF-WAY. 18" BACK OF SIDEWALK WHEN SIDEWALK IS ADJACENT TO CURB.
- ④ 4 INCH WIDE REFLECTIVE TAPE



APPROVED BY:	<i>[Signature]</i>	10-5-15
LOUIS ABI-YOUNES, CITY ENGINEER	RCE	DATE
RECOMMENDED:	<i>[Signature]</i>	9/17/15
DENNIS MEJIA, UTILITIES ENGINEERING DIRECTOR	RCE	DATE
62268		
REV	DESCRIPTION	BY
		APP'D
		DATE

<b>CITY OF ONTARIO</b>	
<b>6" FIRE HYDRANT INSTALLATION (PVC PIPE)</b>	STANDARD DRAWING NUMBER  <b>4111</b>