


1. ALL BLOW-OFFS SHALL HAVE GUARD POST IN UNPAVED AREAS PER STD. 4303
2. TRACER WIRE TO BE TAPED TO PIPELINE EVERY 10 FT.
3. HYDRANTS AND/OR BLOW OFFS TO BE PAINTED WITH PRIMER AND TWO (2) COATS OF YELLOW ACME PAINT, NO. 2-19057 OR APPROVED EQUAL. (NO PAINT ON BRASS OR BRONZE).



NOTES

- ① 18" BEHIND CURB WHEN THE SIDEWALK IS ADJACENT TO THE RIGHT-OF-WAY.
- ② 18" BACK OF SIDEWALK WHEN SIDEWALK IS ADJACENT TO CURB.

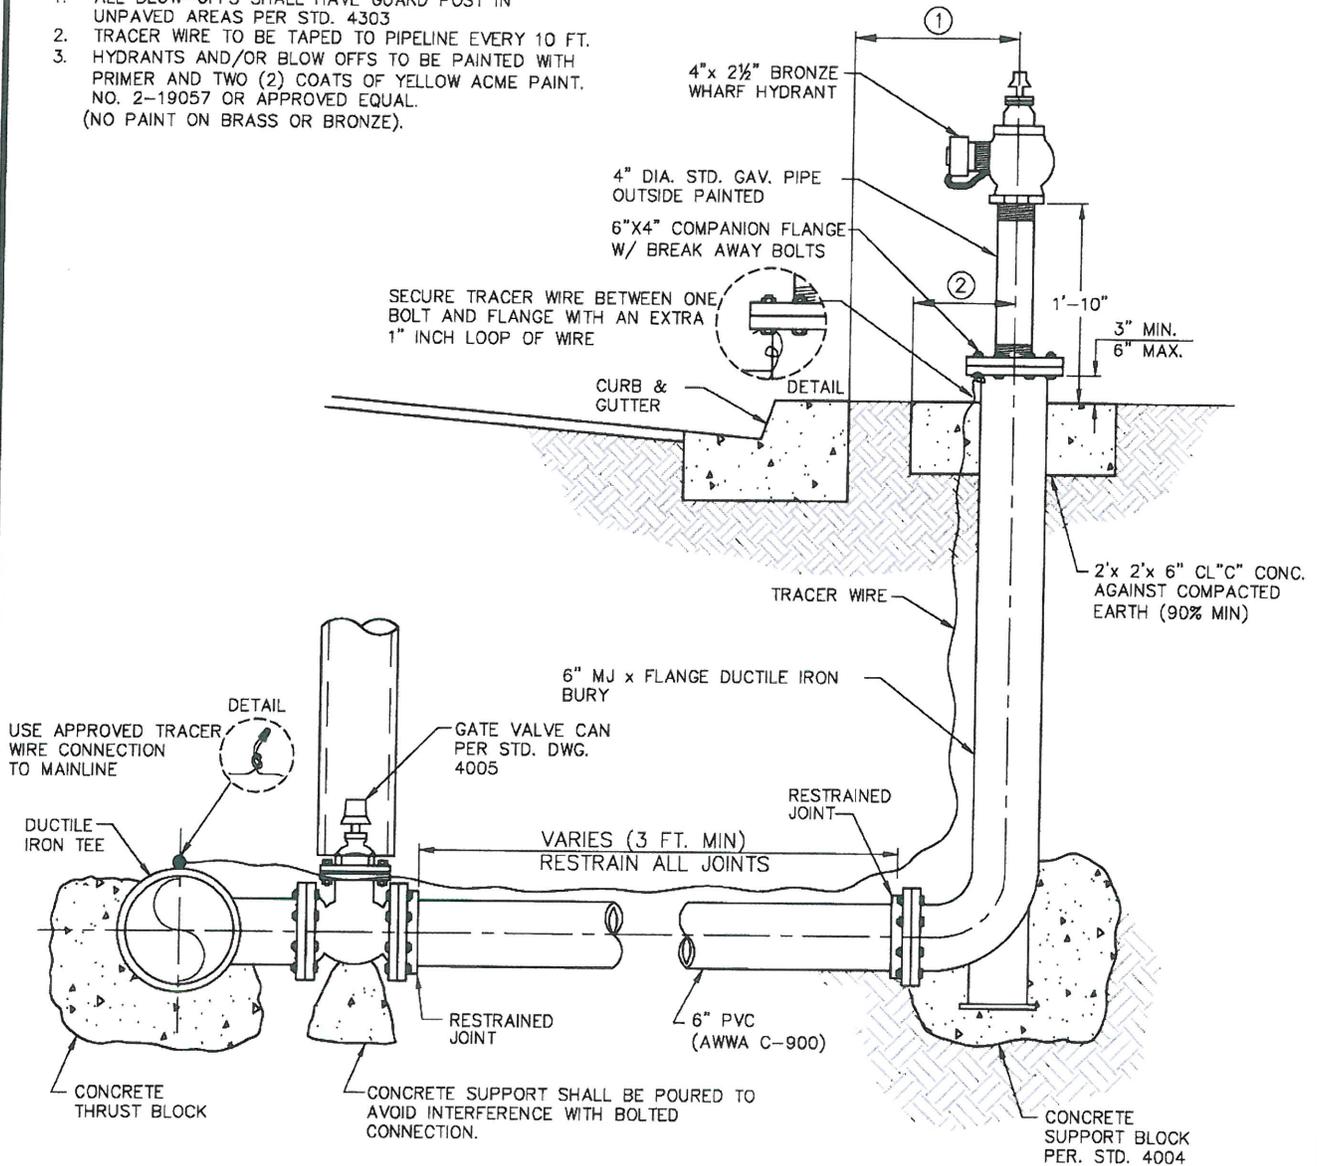

| | | | |
|--|-------------|---------|------------|
| APPROVED BY: | | 10.5.15 | |
| <i>Louis Abi-Younes</i> | | 44485 | |
| LOUIS ABI-YOUNES, CITY ENGINEER | RCE | DATE | |
| RECOMMENDED: | | 9/17/15 | |
| <i>Dennis Mejia</i> | | 62268 | |
| DENNIS MEJIA, UTILITIES ENGINEERING DIRECTOR | RCE | DATE | |
| REV | DESCRIPTION | BY | APP'D DATE |
| | | | |

CITY OF ONTARIO

4" BLOWOFF ASSEMBLY
(PVC PIPE)

STANDARD
DRAWING
NUMBER

4112