




# ONTARIO FIRE DEPARTMENT FIRE PROTECTION STANDARD

**FIRE HYDRANT IDENTIFICATION**  
STANDARD #D-002      EFFECTIVE 04-01-2015      PAGES 1

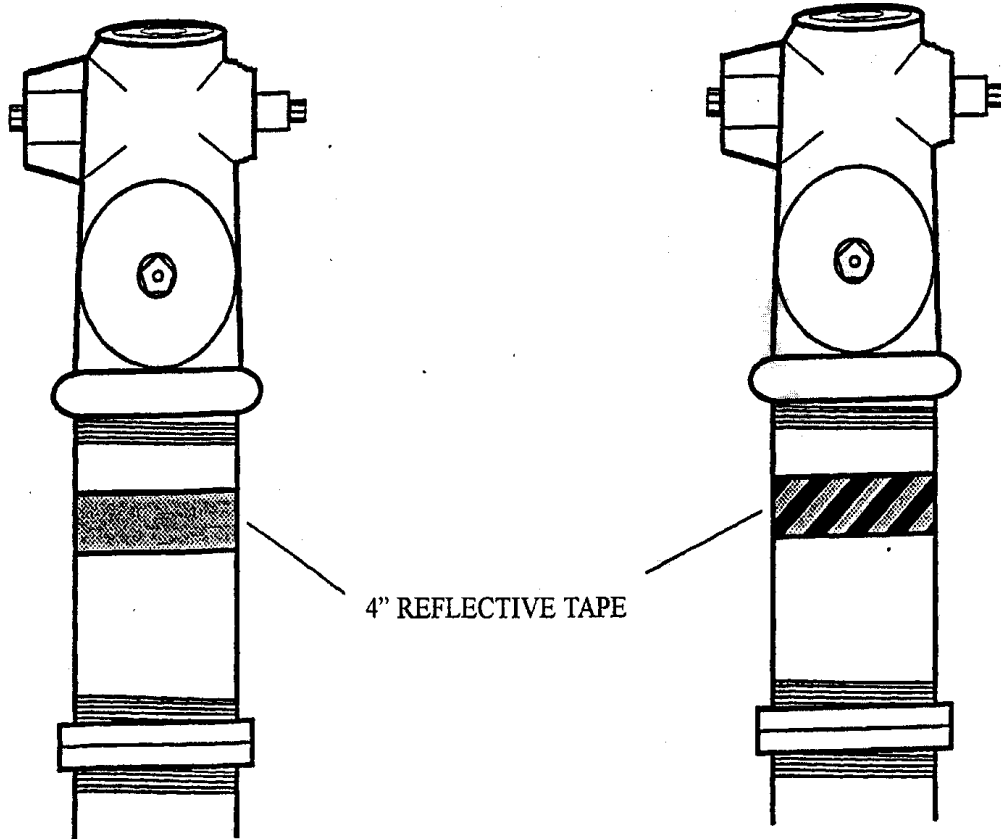

White Tape = Public Hydrant  
Red Tape = Private Hydrant

Yellow/Black Stripe Tape =  
Private Hydrant Supplied by Fire Pump

## PURPOSE:

This standard is provided to serve as a visual example of the proper identification measures for fire hydrants in the City of Ontario.

## SPECIFICATIONS:

1. Prime coat must be Rust-Oleum No. 960 Rust Inhibitive Yellow Primer or approved equal.
2. Finished paint coat shall be Yellow Exterior Enamel or approved equal.
3. Reflective tape shall be 4" wide self-adhesive tape applied with a 1.5" overlap of the seam.  
Red - 3M™ Scotchlite™ Reflective Striping Tape 79974; yellow/black to be Reflexite AP-1000 or approved equal.
4. Install blue reflective pavement marker per City of Ontario Standard Drawing No. 4302.
5. Do not paint brass hydrant threads.