


PROFILE

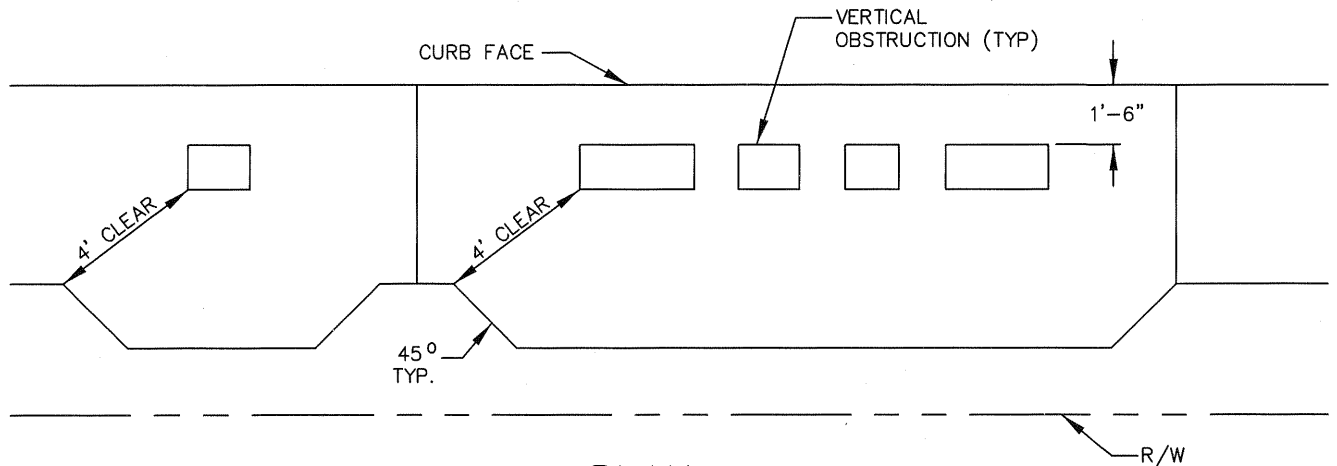

PLAN

NOTES

1. THE DISTANCE FROM THE CURB FACE TO ANY PART OF A FIRE HYDRANT SHALL BE NOT LESS THAN TWO (2) FEET OR GREATER THAN SEVEN (7) FEET.
2. FOR ANY VERTICAL OBSTRUCTION THE MINIMUM CLEARANCE FROM THE CURB SHALL BE 1 FOOT - 6 INCHES.
3. THE MINIMUM WIDTH OF CLEAR SIDEWALK SHALL BE FOUR (4) FEET FROM ANY VERTICAL OBSTRUCTION.
4. ANY UTILITY VAULT WITHIN THE SIDEWALK AREA SHALL HAVE A BOLT-DOWN COVER WITH A SLIP RESISTANT FINISH.
5. ANY PARKWAY OBSTRUCTION SHALL BE SURROUNDED BY A CONCRETE PAD.
6. REFER TO STANDARD DRAWINGS 1209, 1210, 1211 FOR SIDEWALK CONSTRUCTION. CONTROL JOINTS SHALL BE LOCATED TO THE SATISFACTION OF THE CITY INSPECTOR.



APPROVED BY:				
<i>John P. Sullivan</i>				
24079 8/08/06				
JOHN P. SULLIVAN CITY ENGINEER RCE DATE				
RECOMMENDED BY:				
<i>Chris P. Yon</i>				
44485 8/07/06				
CHRIS P. YON CITY ENGINEER RCE DATE				
REV	DESCRIPTION	BY	APP'D	DATE

CITY OF ONTARIO

PARKWAY  
OBSTRUCTIONS I -  
CURB ADJACENT

STANDARD  
DRAWING  
NUMBER

**1216**