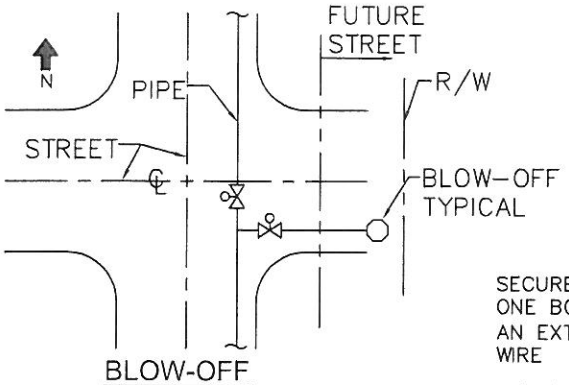

BLOW-OFF OPERATOR POSITION

1. ALL BLOW OFFS IN UNPAVED AREAS SHALL HAVE GUARD POST IN UNPAVED AREAS PER STD. 4303.
2. TRACER WIRE TO BE TAPED TO PIPELINE EVERY 10 FT.
3. HYDRANTS AND/OR BLOW OFFS TO BE PAINTED WITH PRIMER AND TWO (2) COATS OF YELLOW ACME PAINT. NO. 2-19057 OR APPROVED EQUAL. (NO PAINT ON BRASS OR BRONZE).

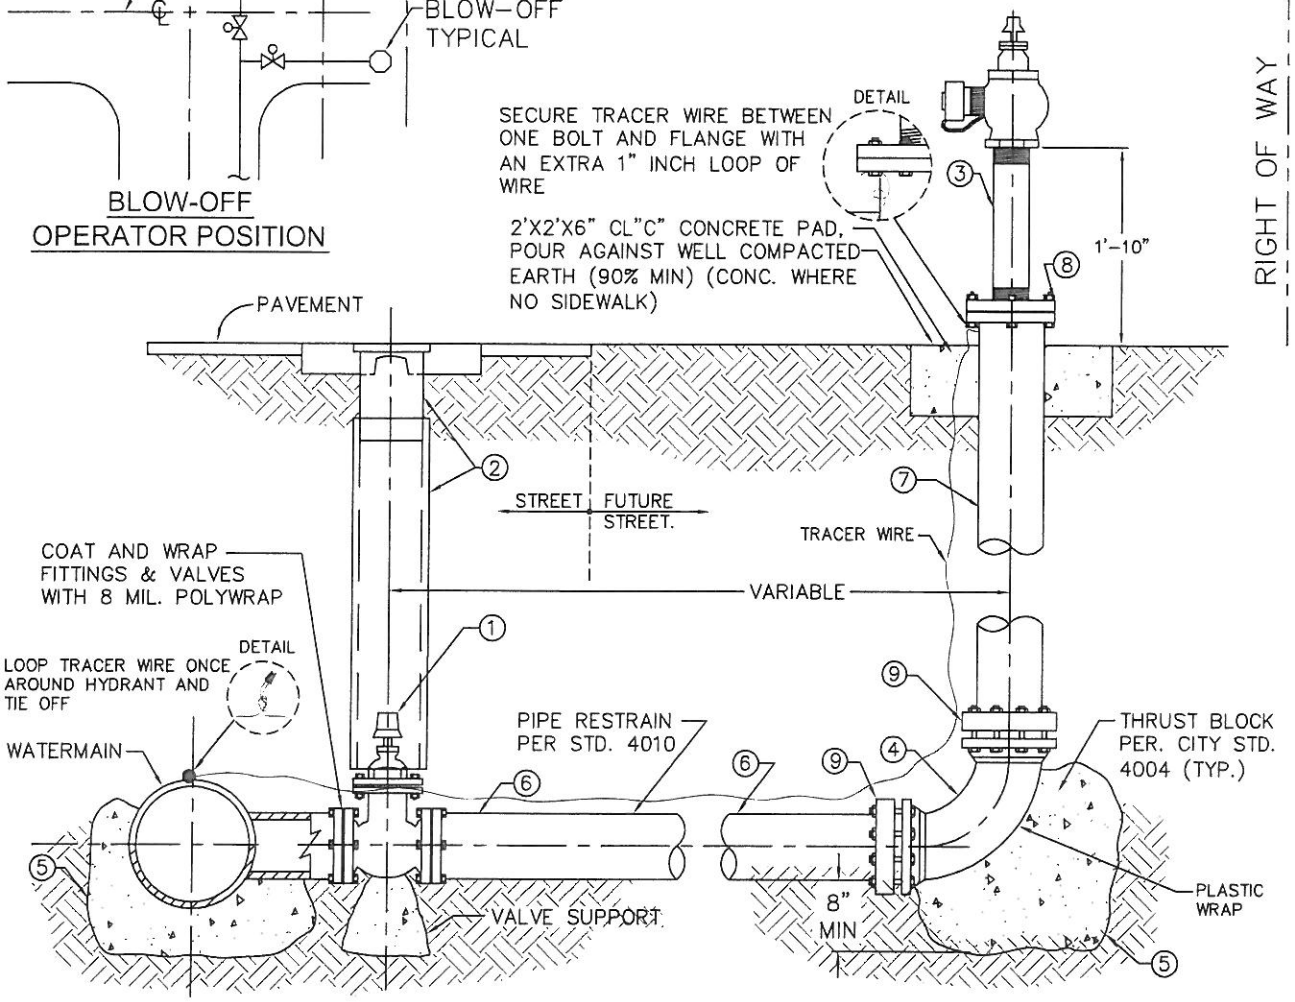

NOTES

1. 8" DIA. A.W.W.A. C-509 (LATEST) FLG'D. RESELIENT RESILIENT SEAT GATE VALVE, PER STD. DWG. 4005
2. STANDARD VALVE BOX INSTALLATION PER STD. 4005
3. 4" DIA. STD. GAV. NIPPLE, OUTSIDE PAINTED.
4. 8" DIA. MJ 90° BEND
5. THRUST BLOCK PER STD. DWG. 4004
6. 8" DIA. PVC AWWA C-900 W/ LOCATER WIRE
7. 8" D.I. FLANGE X SLIP SPOOL
8. 8"X4" COMPANION FLANGE (A.S.A. 150LB.)
9. PIPE RESTRAINT
10. M.J. X FLANGE 90° BEND
11. M.J. X FLANGE REDUCER

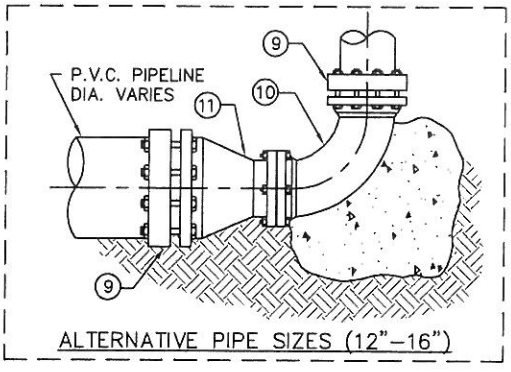

ALTERNATIVE PIPE SIZES (12"-16")

REGISTERED PROFESSIONAL ENGINEER
LOUIS ABI-YOUNES
No. 44485
EXP. 03/31/12
CIVIL
STATE OF CALIFORNIA

APPROVED BY: Louis Abi-Younes 11-22-10
LOUIS ABI-YOUNES, CITY ENGINEER — 44485 — RCE — DATE

RECOMMENDED: Scott Burton 10/25/10
SCOTT BURTON, UTILITIES ENG/OPERATIONS DIRECTOR — 57875 — RCE — DATE

REV	DESCRIPTION	BY	APP'D	DATE

CITY OF ONTARIO

NMC
TEMPORARY DEAD-END
4" BLOWOFF

STANDARD DRAWING NUMBER
4113